


CHILLED WATER SYSTEM

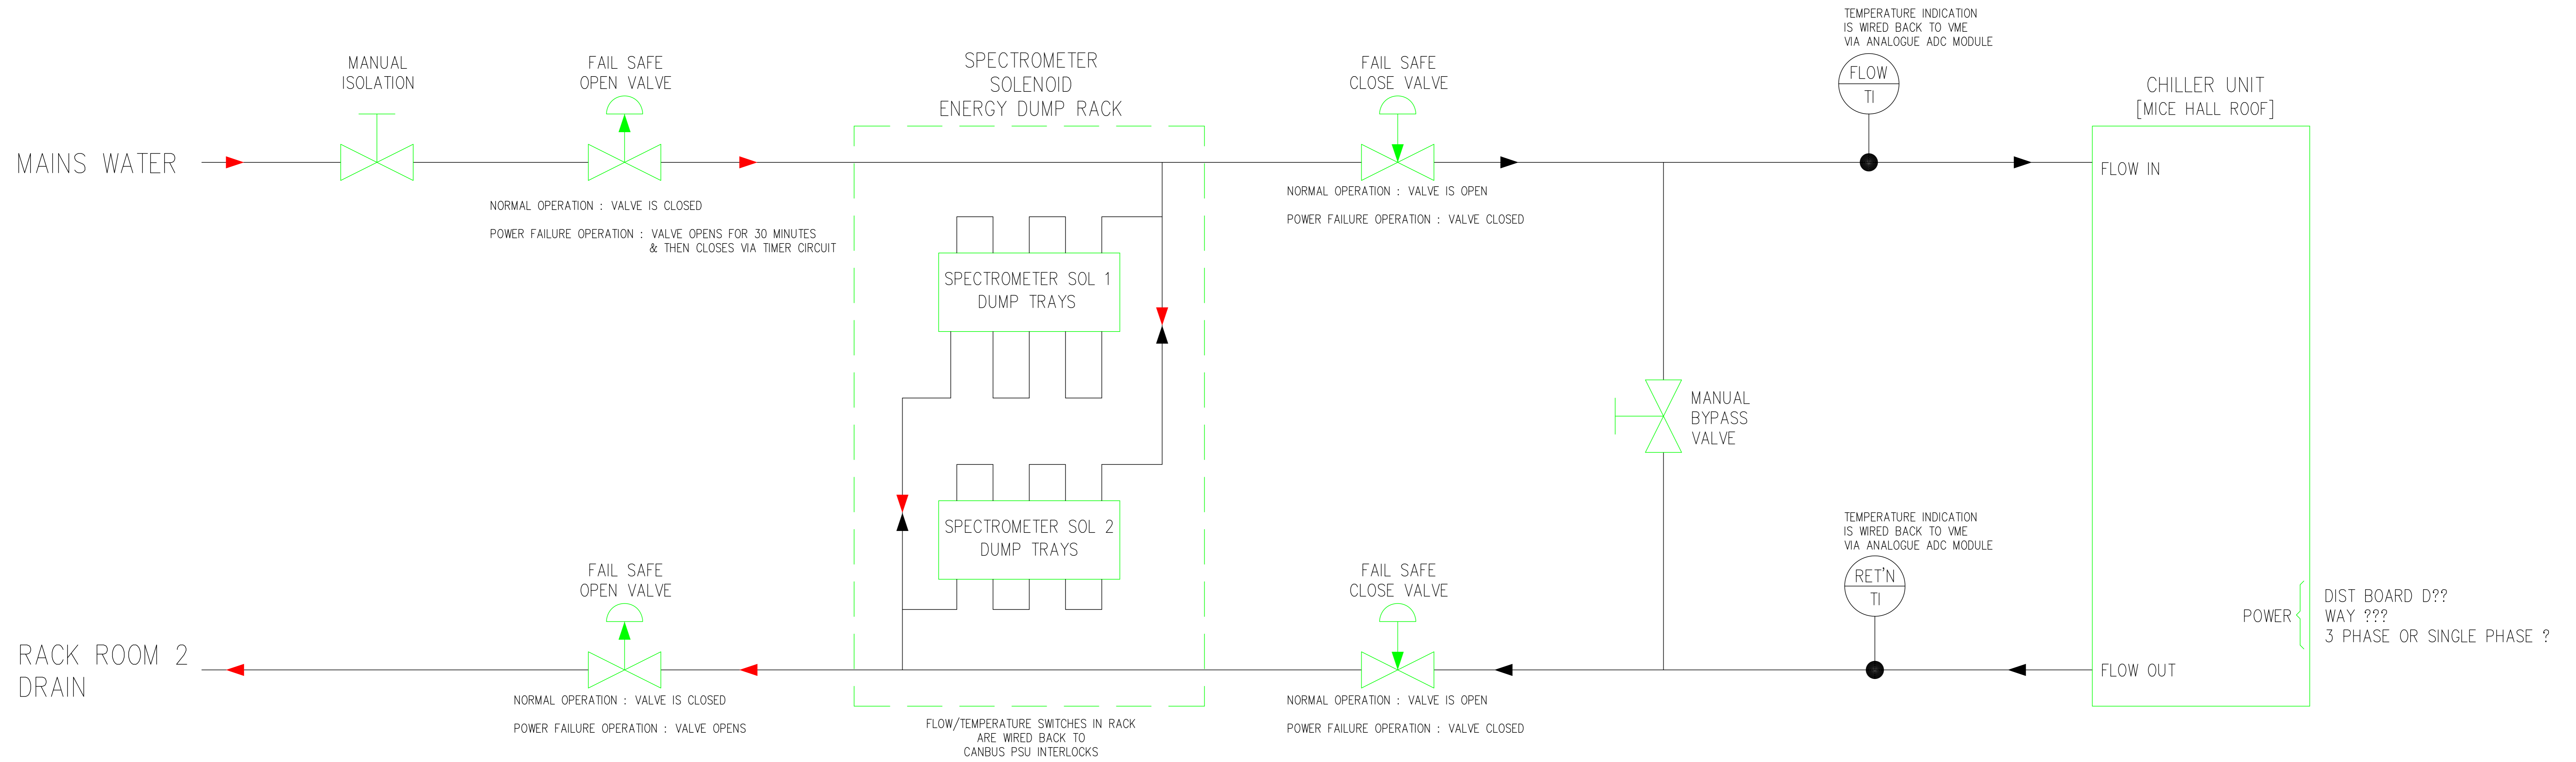

KEY

- ▶ WATER FLOW UNDER NORMAL OPERATION
- ▶ WATER FLOW UNDER POWER FAILURE CONDITIONS

ISSUED FOR COMMENT

SCALE		0	
ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE STATED			
DRN	J.W.W.	SCIENCE AND TECHNOLOGY FACILITIES COUNCIL	
DATE	JAN 2015	DARESBURY LABORATORY	
CKD		CHESHIRE	
DATE		TITLE	
CERT		SPECTROMETER SOLENOID	
DATE		CHILLED WATER SYSTEM	
APPD		SCHEMATIC	
DATE		DRG No	ISSUE
		AO-SKETCH	SHT 1 OF 1
		CAD PART No	A
DRAWING LIST: - DL204/73000			
CONTRACTORS COMPANY			
CONTRACTORS DRG No			

FIRST ISSUE